REV.	ZONE	ECN NO.	DATE	BY	CKR	APP.

Phil Pape, Controls Division 5/16/2002 1:17 PM permit_wiring.dwg

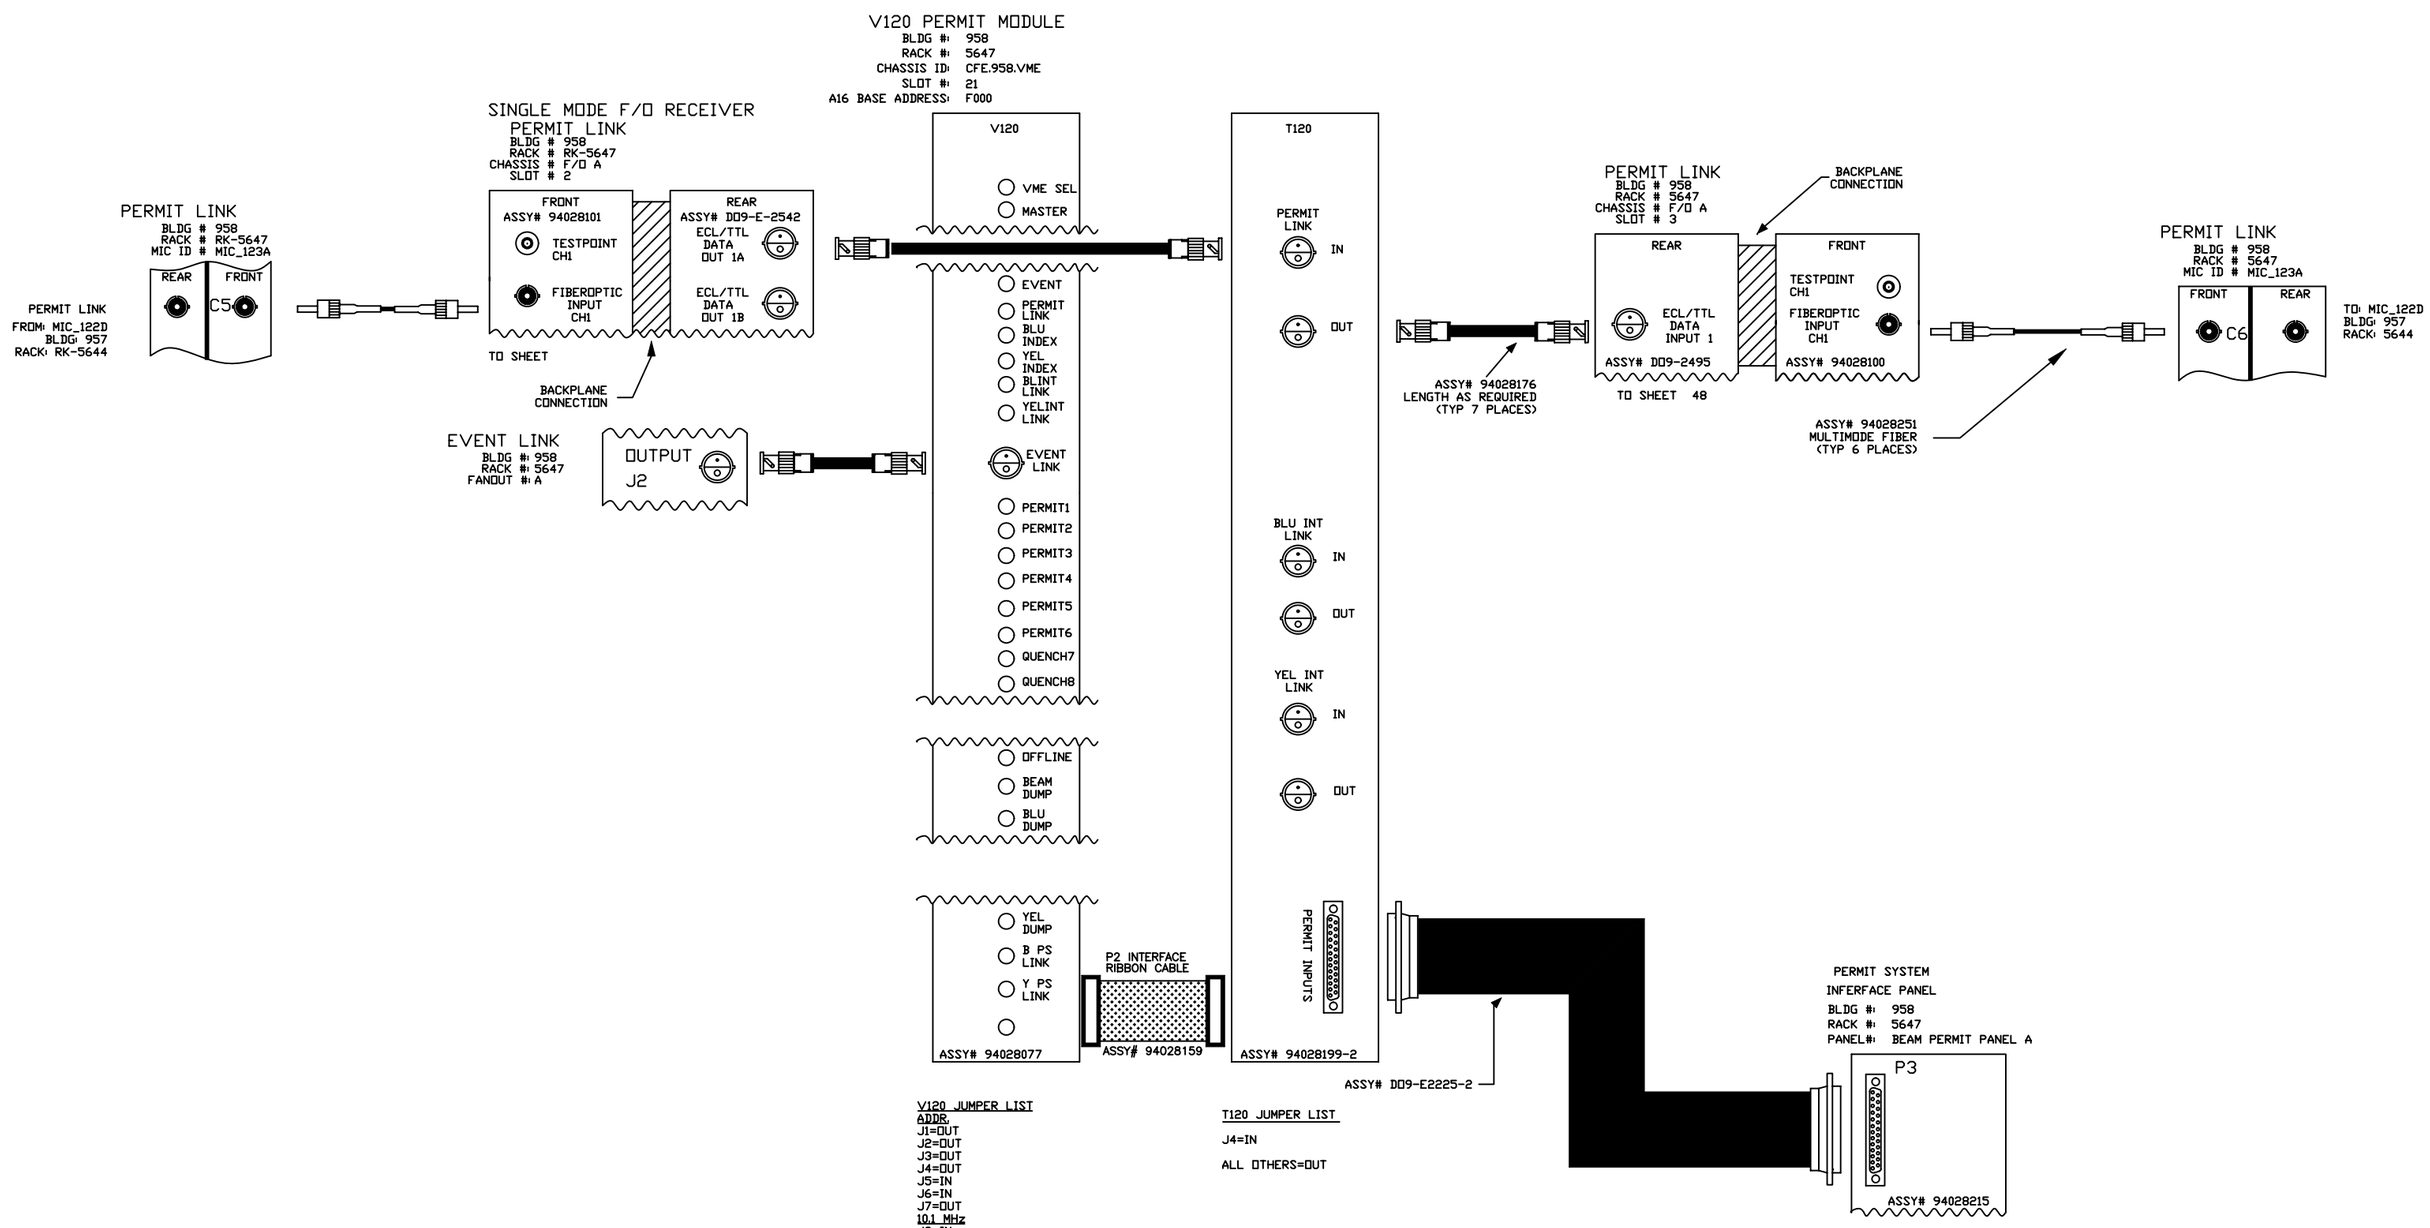

V120 JUMPER LIST
ADDR.
J1=OUT
J2=OUT
J3=OUT
J4=OUT
J5=IN
J6=IN
J7=OUT
10.1 MHz
J8=IN
J9=OUT
J10=OUT
QUENCH INPUTS ARE PERMIT
J11=OUT
MASTER
J12=IN
QUENCH DISABLE
J13=IN
J14=IN

T120 JUMPER LIST

J4=IN

ALL OTHERS=OUT

-3 / -2 / -1 QTY REQD	REF DESIGNATOR	ITEM NO.	DESCRIPTION	MAT'L DWG NO.,BNL NO.

INTERPRET IN GENERAL ACCORDANCE WITH ASME Y14.24M-1989	Q.A. CATEGORY A-3	DATE	BROOKHAVEN NATIONAL LABORATORY
	DRAWN BY PAPE	05/16/02	UPTON, N.Y. 11973
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES	CHECKED BY		CA – CONTROLS WIRING DIAGRAM
DECIMAL TOLERANCES .X ±.030 .XX ±.015 .XXX ±.005 ANGULAR TOLERANCE ± .5°	DESIGN APPROVAL		BAF BLDG 958, CHASSIS CFE.958.VME
	ENGINEER APPROVAL		V120/T120 PERMIT MASTER
	SUPVR. APPROVAL		SIZE D / DRAWING NUMBER / REV. A
OUTSTANDING ECN	NA FINISH	BREAK SHARP EDGES MAX. XX MIN. XX	NEXT ASSEMBLY
			MATERIAL: ——— SCALE: NA WEIGHT: – SHEET

*AUTOCAD